



County of San Diego  
Department of Planning and Land Use  
**BUILDING DIVISION**

**ACCESSIBILITY CORRECTION LIST**

Multifamily Housing

**11A**

**Drinking Fountains**

PLAN CHECK NUMBER:

OWNER:


**SCOPING**

1. Drinking fountains and water coolers provided in common-use spaces shall be accessible.  
*CBC 1139A.1*
2. Each accessible drinking fountain and water cooler shall be on an accessible route allowing forward approach.  
*CBC 1139A.2 and CBC 1139A.3*
3. All drinking fountains – accessible or otherwise – shall be located within alcoves, wing walls, or otherwise positioned so as not to encroach into pedestrian ways.  
*CBC 1139A.3.1*


**DIMENSIONS AND FEATURES**

4. Dimension minimum 32-inch-wide by 18-inch-deep drinking fountain alcoves per CBC Figure 11A-11A(a).  
**Exception:** Minimum 32-inch-wide by 18-inch-deep wing walls per CBC Figure 11A-11A(b) acceptable if extending to within 6 inches of floor  
**Exception:** Additional width required at alcoves or wing walls with depth greater than 24 inches per CBC Figure 11A-1H(b)  
*CBC 1139A.3.1*

5. Specify maximum 4-inch projection of protruding objects into required alcoves or adjacent pedestrian ways.  
*CBC 1139A.3.1*
6. Detail drinking fountain clearances complying with the following:
  - ☐ Minimum 30-inch-wide knee space
  - ☐ Minimum 18-inch-deep knee space
  - ☐ Minimum 27-inch-high and 8-inch-deep clear and unobstructed knee space beneath drinking fountain as measured from front edge
  - ☐ Minimum 9-inch-high and 17-inch deep toe clearance measured from front edge  
*CBC 1139A.3(1)*
7. Specify water flow and activation complying with the following:
  - ☐ Spout located maximum 36 inches above floor
  - ☐ Spout located maximum 6 inches from front edge
  - ☐ Water flow minimum 4 inches high
  - ☐ Water flow substantially parallel to front edge
  - ☐ Controls located maximum 6 inches from front edge
  - ☐ Controls operable with maximum 5 pounds of force
  - ☐ Controls operable with one hand and without tight grasping, pinching, or twisting of wrist.  
*CBC 1139A.3(2)*

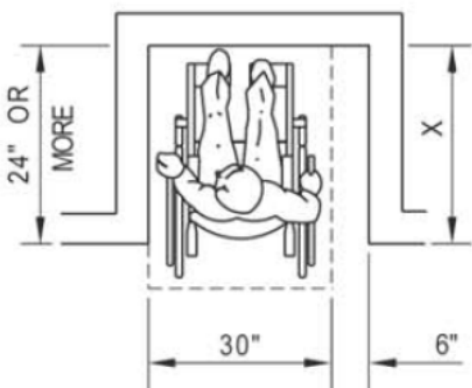

NOTE : IF X > 24 INCHES, THEN AN ADDITIONAL MANEUVERING CLEARANCE OF 6 INCHES SHALL BE PROVIDED AS SHOWN.

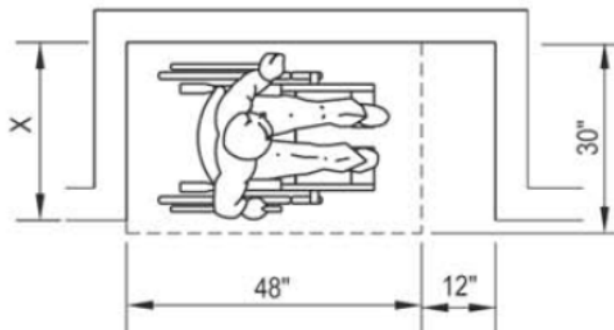


NOTE : IF X > 15 INCHES, THEN AN ADDITIONAL MANEUVERING CLEARANCE OF 12 INCHES SHALL BE PROVIDED AS SHOWN.

**CBC FIGURE 11A-1H(b) – ALCOVE MANEUVERING SPACE**


**THIS DOCUMENT IS FOR PLAN REVIEW ONLY.  
CORRECTION LIST ITEMS MAY NOT BE REPRODUCED OR COPIED ON PLANS.  
PROVIDE COMPLETE DETAILS, DIMENSIONS, AND NOTES TO SATISFY CORRECTION ITEMS.**

**5201 RUFFIN ROAD, SUITE B, SAN DIEGO, CA 92123 • (858) 565-5920 • (888) 336-7553**

**[HTTP://WWW.SDCPLU.ORG](http://www.sdcplu.org)**

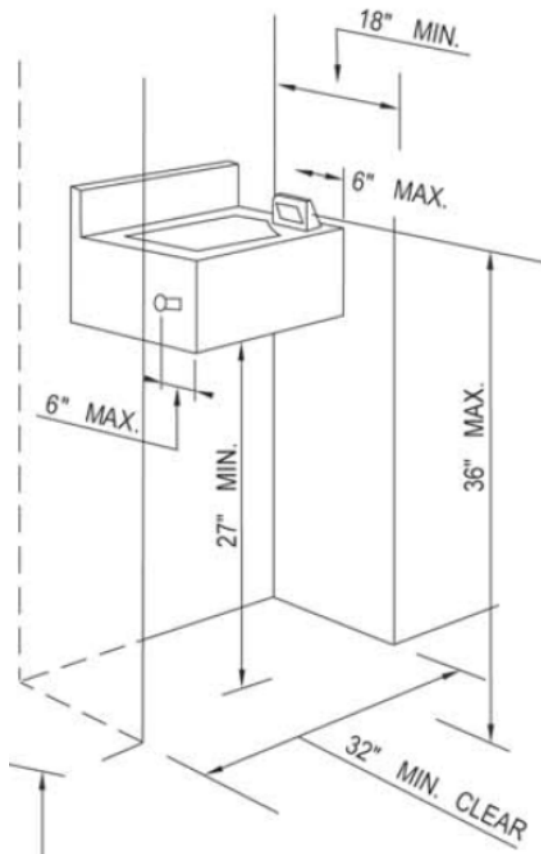

CBC FIGURE 11A-11A(a) – DRINKING FOUNTAIN ALCOVE

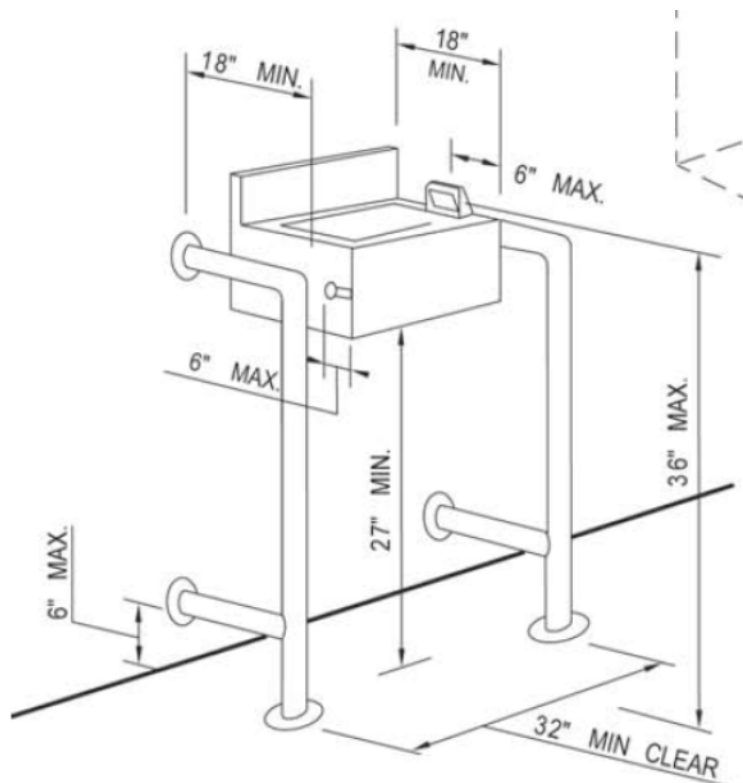

CBC FIGURE 11A-11A(b) – DRINKING FOUNTAIN WING WALLS

**THESE FIGURES ARE FOR ILLUSTRATIVE PURPOSES ONLY.  
THEY ARE NOT INTENDED FOR REPRODUCTION AS PLAN DETAILS.  
IF CONFLICTS EXIST BETWEEN THESE FIGURES AND THE TEXT  
OF THE CALIFORNIA BUILDING CODE, THE CODE TEXT SHALL GOVERN.**